




55%

## KASALOVA PILA, JINDŘICHŮV HRADEC, CZE

For the manufacturer of wooden trusses, windows, doors and wooden constructions, Kasalova Pila, s.r.o., we have exchanged unsuitable discharge luminaires for new modern LED luminaires in the production hall. By installing LED luminaires, the customer has saved 55% operating costs while increased the illumination level by 25%.

	Original installation	ARGIA lighting solution
<b>Type of luminary</b>	discharge luminaires 400 W	<b>INDUSTRY HBL 215 W</b>
<b>Number of luminaires</b>	40 pcs	<b>40 pcs</b>
<b>Total Input</b>	19.12 kW	<b>8.60 kW</b>
<b>Consumption kWh/year</b>	95,447 kWh	<b>42,931 kWh</b>


Customer's total operating costs reduced by 55% while increased the illumination level by 25%.

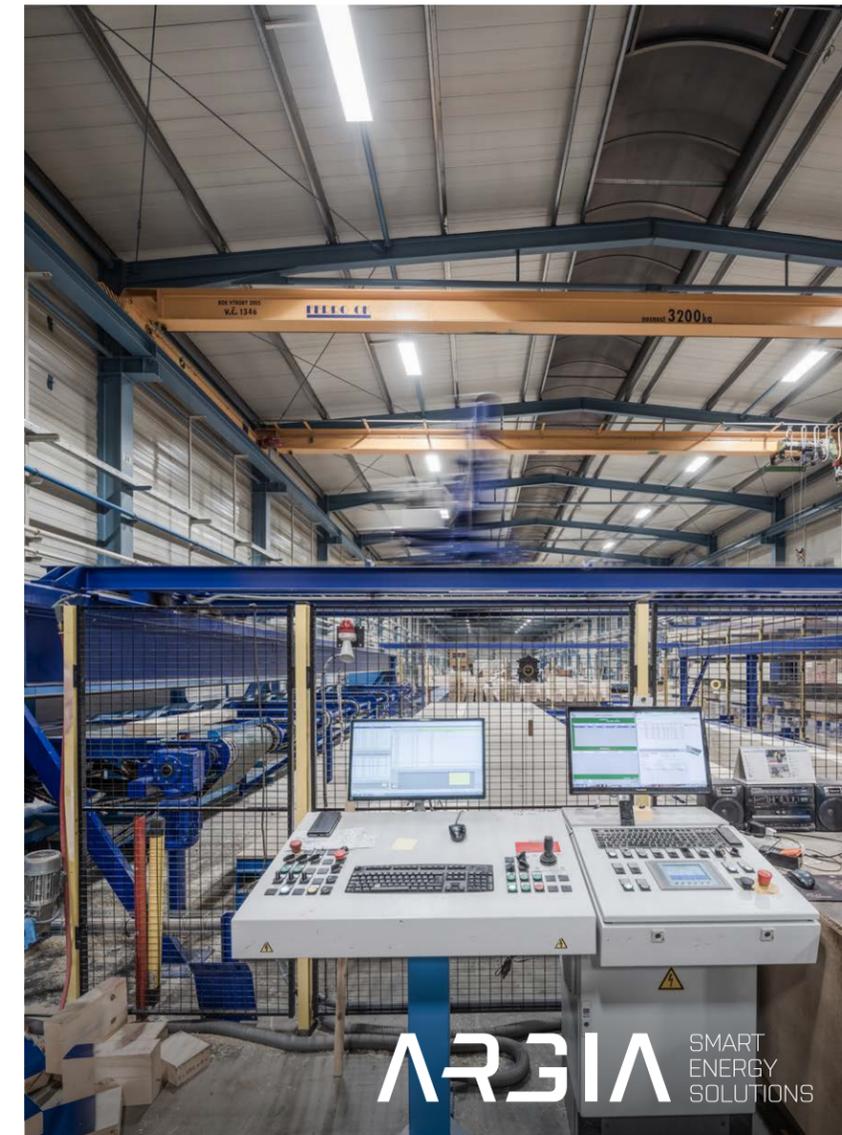



INDUSTRIAL LIGHTING  
ALEMA, LANŠKROUN, CZE

[www.argia.com.mx](http://www.argia.com.mx)

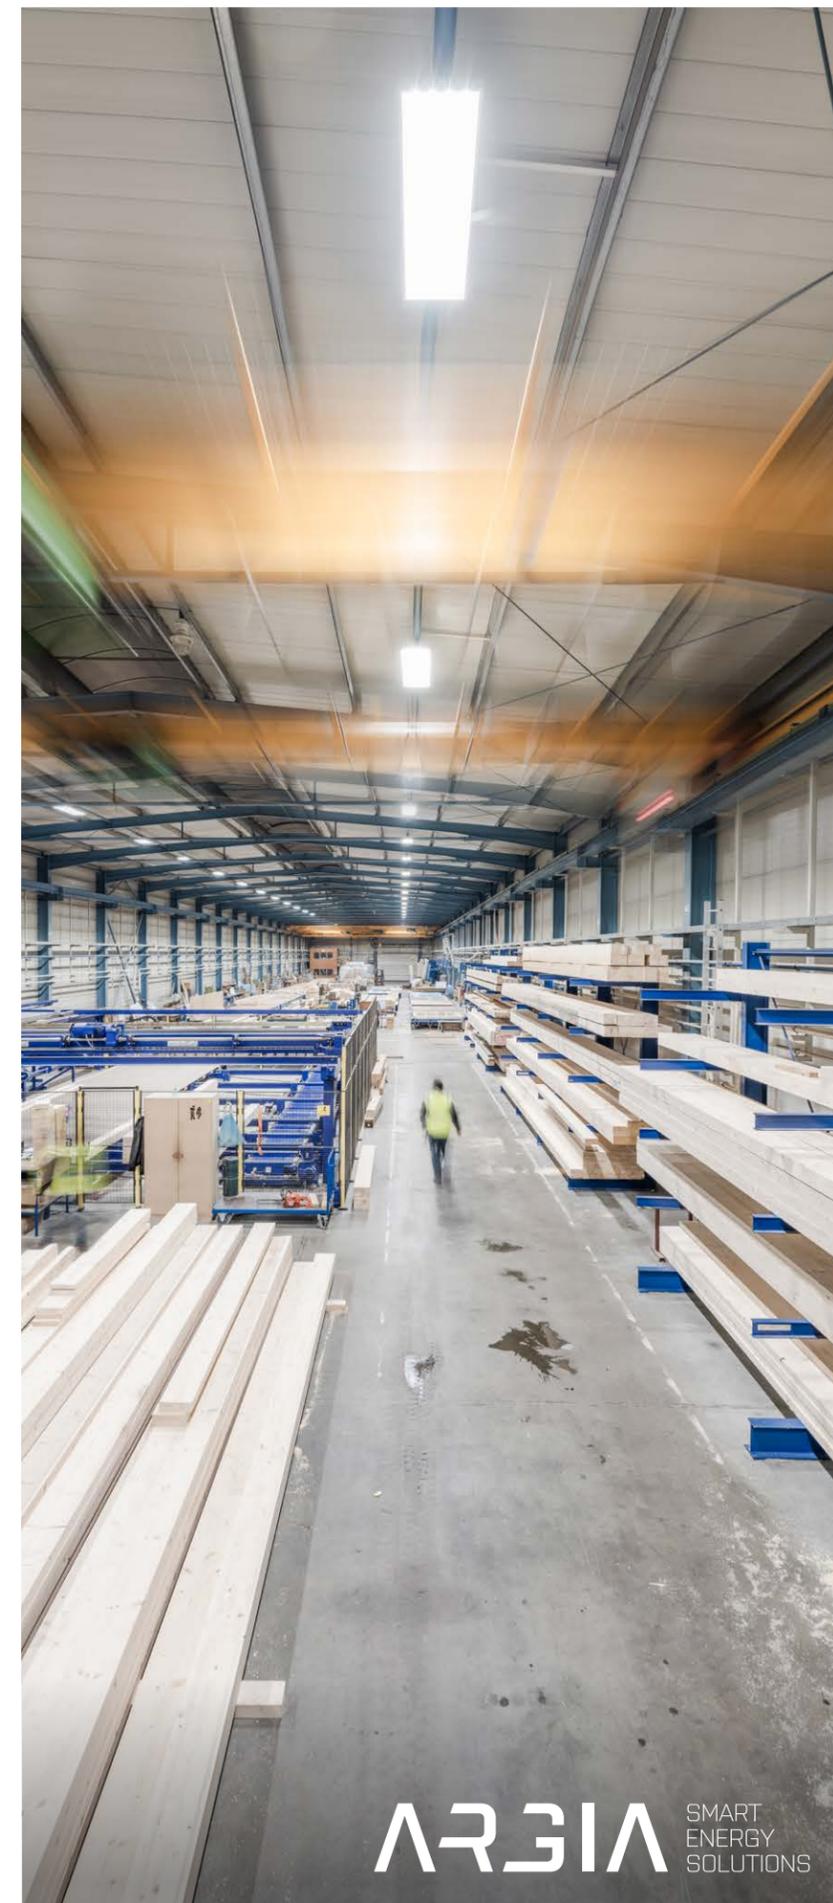

**ARGIA** SMART  
ENERGY  
SOLUTIONS