



55%


PPF GATE, PRAHA, CZE

During the reconstruction work of 3 floors of an office building PPF GATE we conducted the installation of 981 office lightings. Installation, which lasted one month, has been enormously difficult given the short time allotted for the reconstruction of all floors and in coordination with other professions, who worked there at the same time. Office lighting was installed using a wire suspensions, which were fixed directly

into the monolithic structure of the ceiling. Furthermore, it was installed 160 emergency luminaires, both embedded and surface-mounted. Work was done on time and meet the customer's expectations in compliance with all legal conditions for approval and subsequent operation.

	Original installation	ARGIA lighting solution
Type of luminary	Fluorescent luminaires T5	OFFICE EV + LED
Number of luminaires	1 320 units	981 units
Total Input	82,84 kW	37,28 kW
Consumption kWh/year	249 514 kWh	112 279 kWh





Economical, reliable and maintenance-free lighting of office space. Meet all safety requirements for large office buildings.

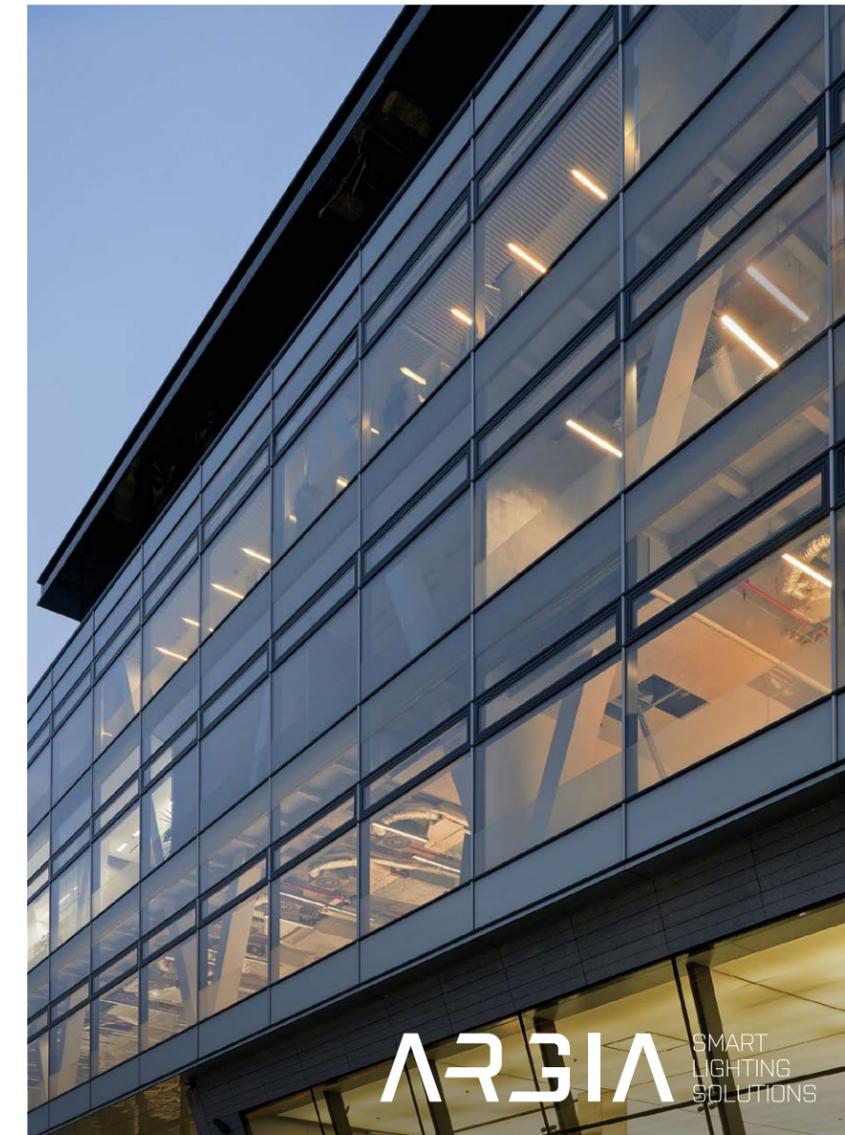



OFFICE AND EMERGENCY LIGHTING
PPF GATE, PRAHA, CZE

www.argia.com.mx

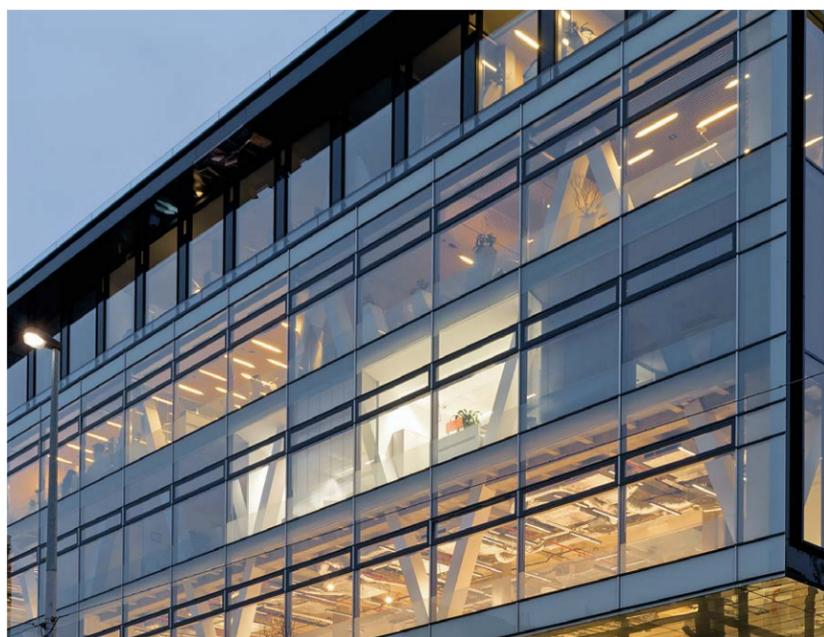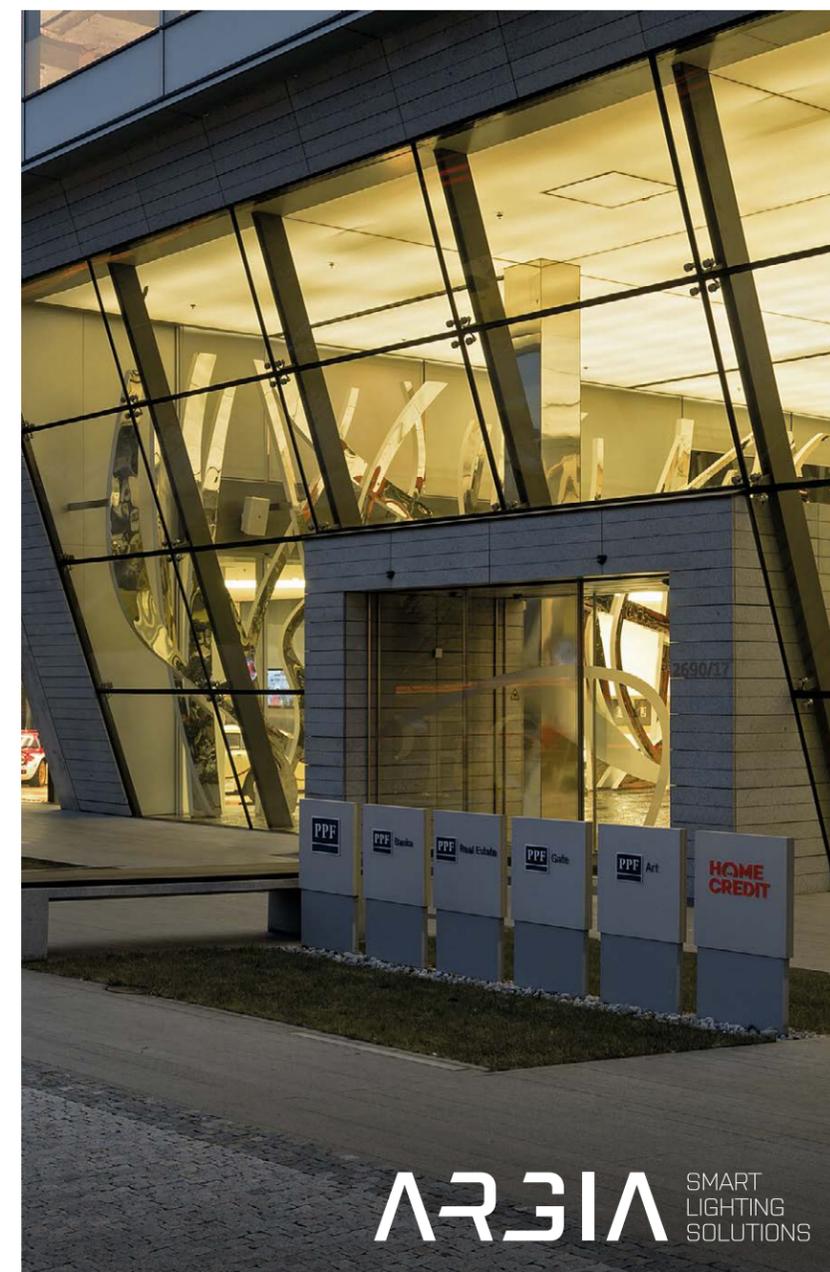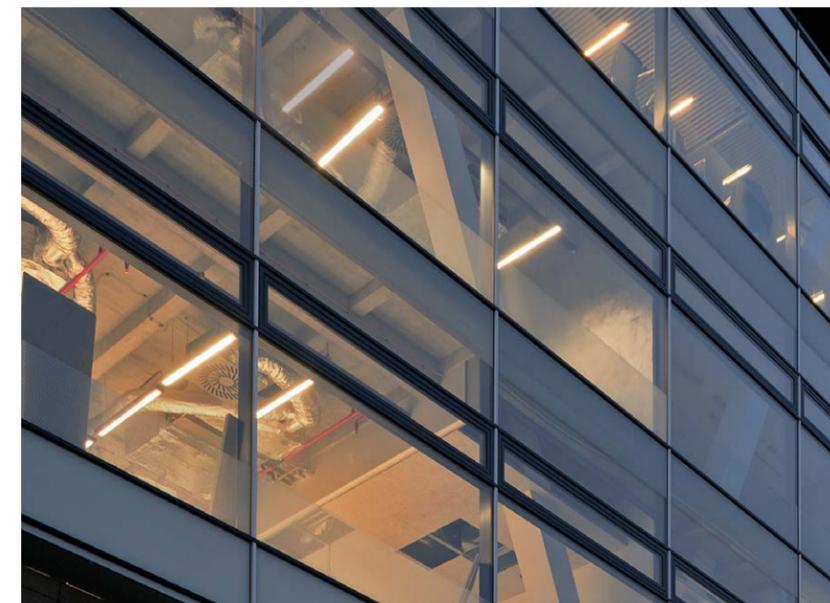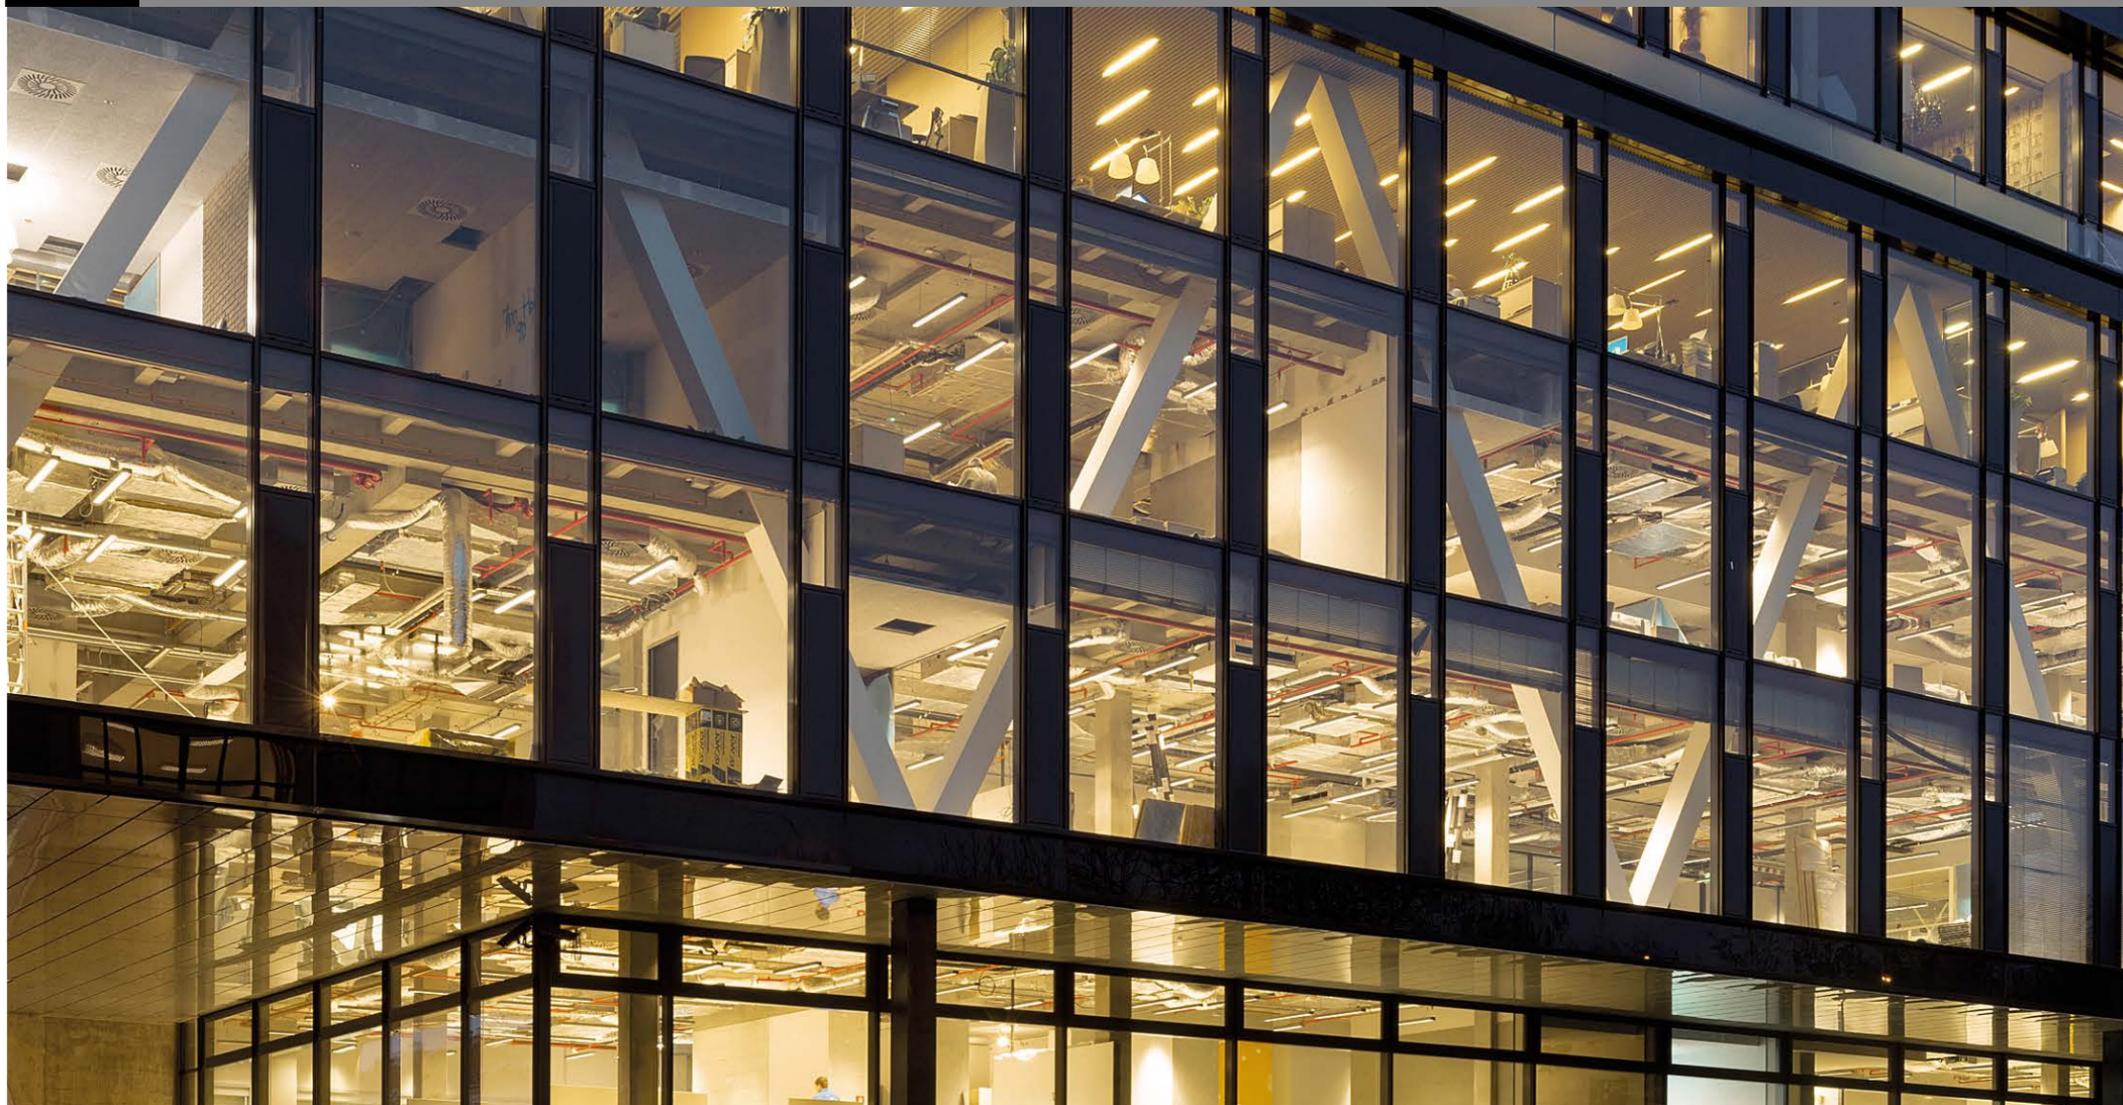

ARGIA SMART
LIGHTING
SOLUTIONS